
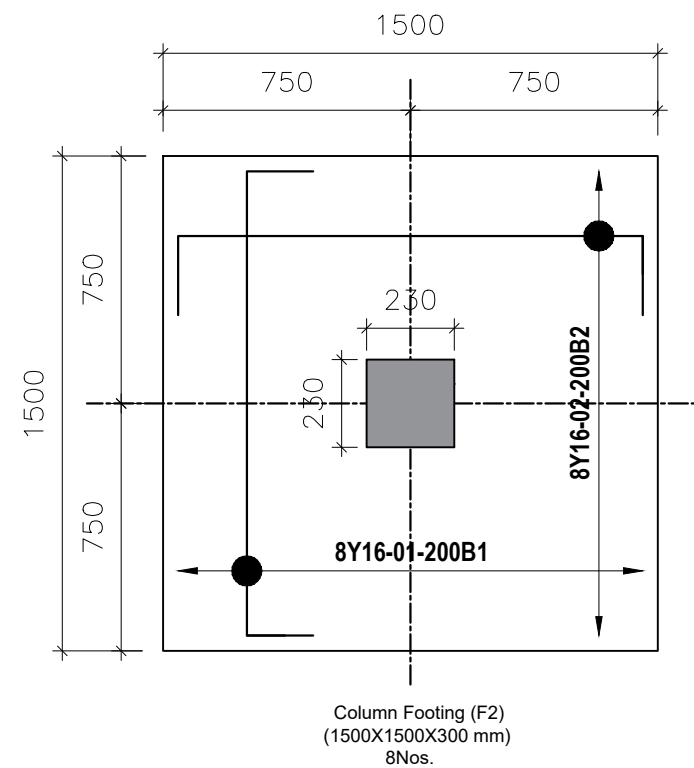
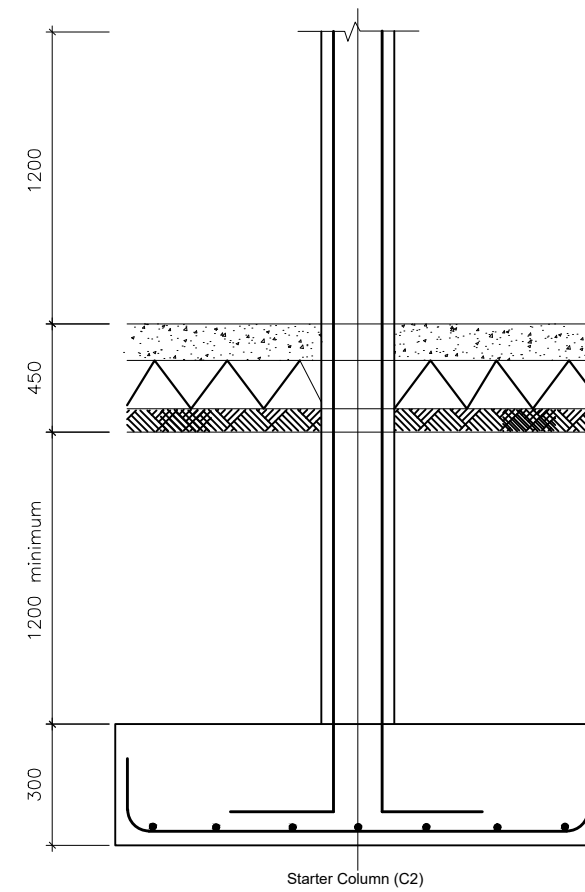
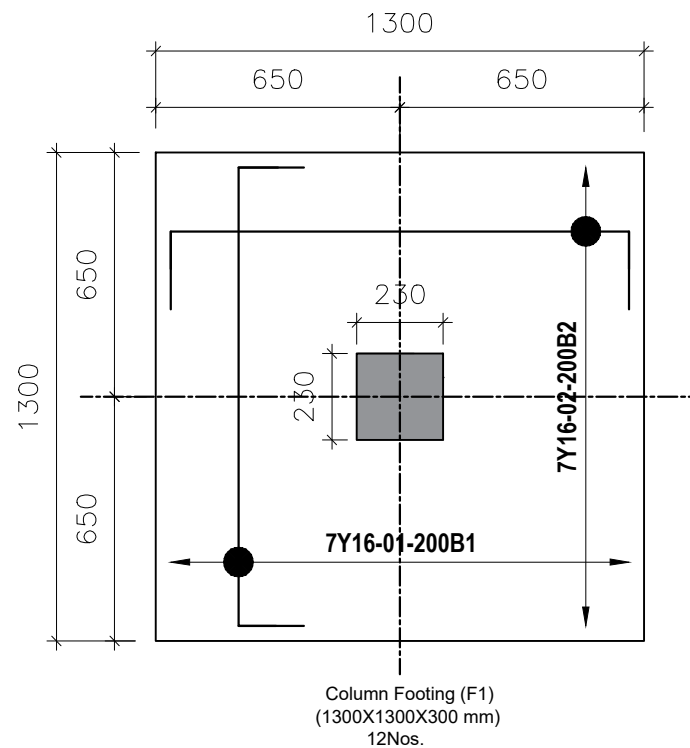
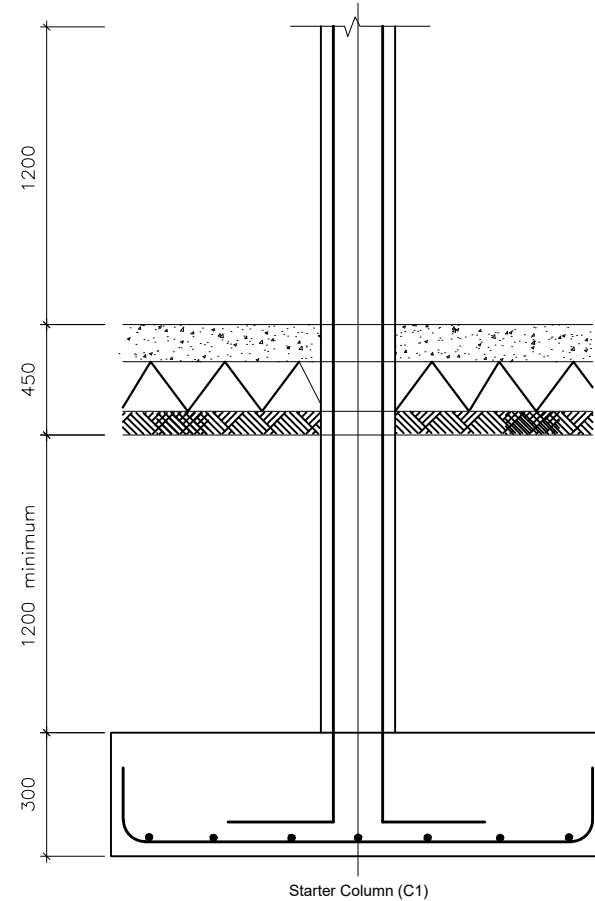
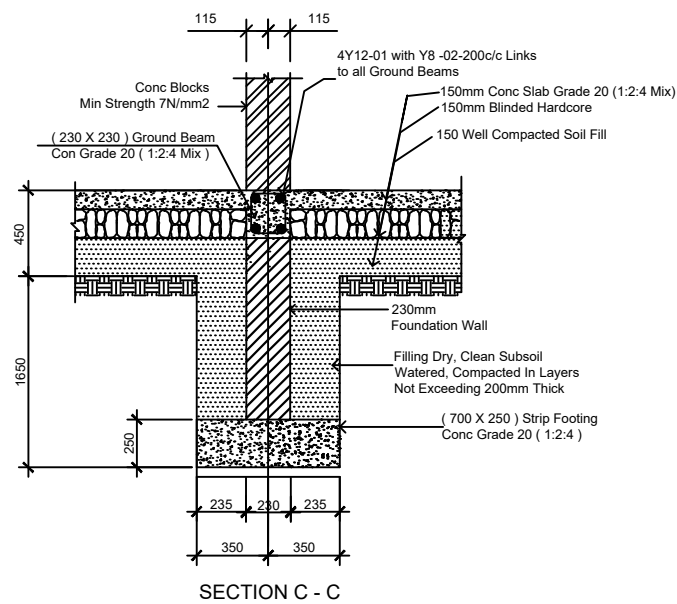
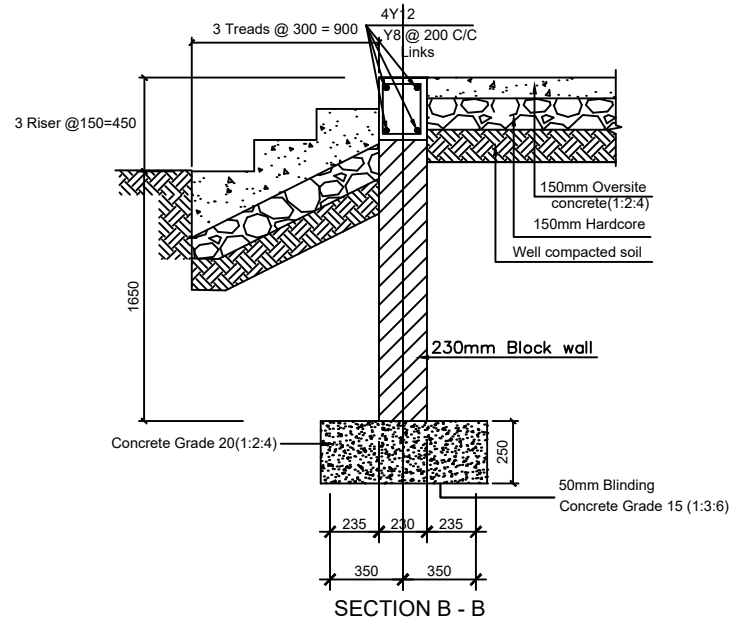


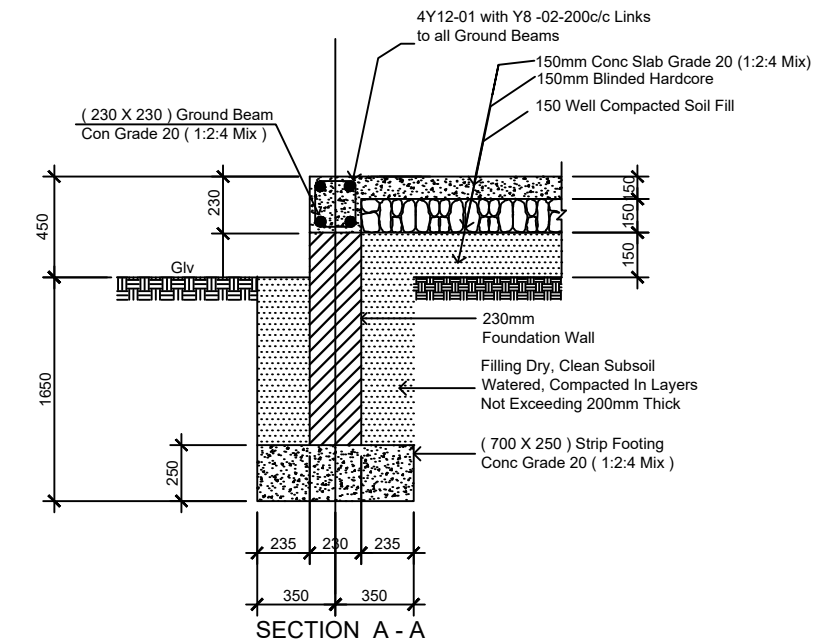

GENERAL NOTES:

- All Dimensions are in mm and levels are in meters.
- All drawings are to be read in conjunction with all relevant Architect's and Engineer's drawings.
- Concrete reinforcement covers should be as follows:
Foundations : 50 mm(min)
Beams : 25 mm(min)
Columns : 25 mm(min)
Slabs : 25 mm(min)
- All concrete works should be cured to BS 8110
- All foundations levels shown are preliminary and have to be confirmed by the Engineer on site in order to obtain specific allowable soil bearing pressure
- Reinforcement shall be:
Main bar type T or Y,
fy=460 N/mm²
Links bar type R, fy= 460N/mm²
- Laps to all reinforcements should be 50Xbar diameter unless noted
- All foundations levels shown are preliminary and have to be confirmed by the Engineer on site in order to obtain specific allowable soil bearing pressure

PROJECT CLIENT:

PROJECT TITLE:

DRAWING NO: STR-02

DRAWING TITLE:

FOUNDATION AND STARTER COLUMN DETAILS.

DESIGNED BY :	I.K
DRAWN BY :	I.K
CHECKED BY :	M.G
APPROVED BY :	M.G
DATE :	AUGUST 2019